


DATE	SYM	REVISION RECORD	AUTH.	DR.	CK.
11/09	-	INITIAL RELEASE	.	WJR	

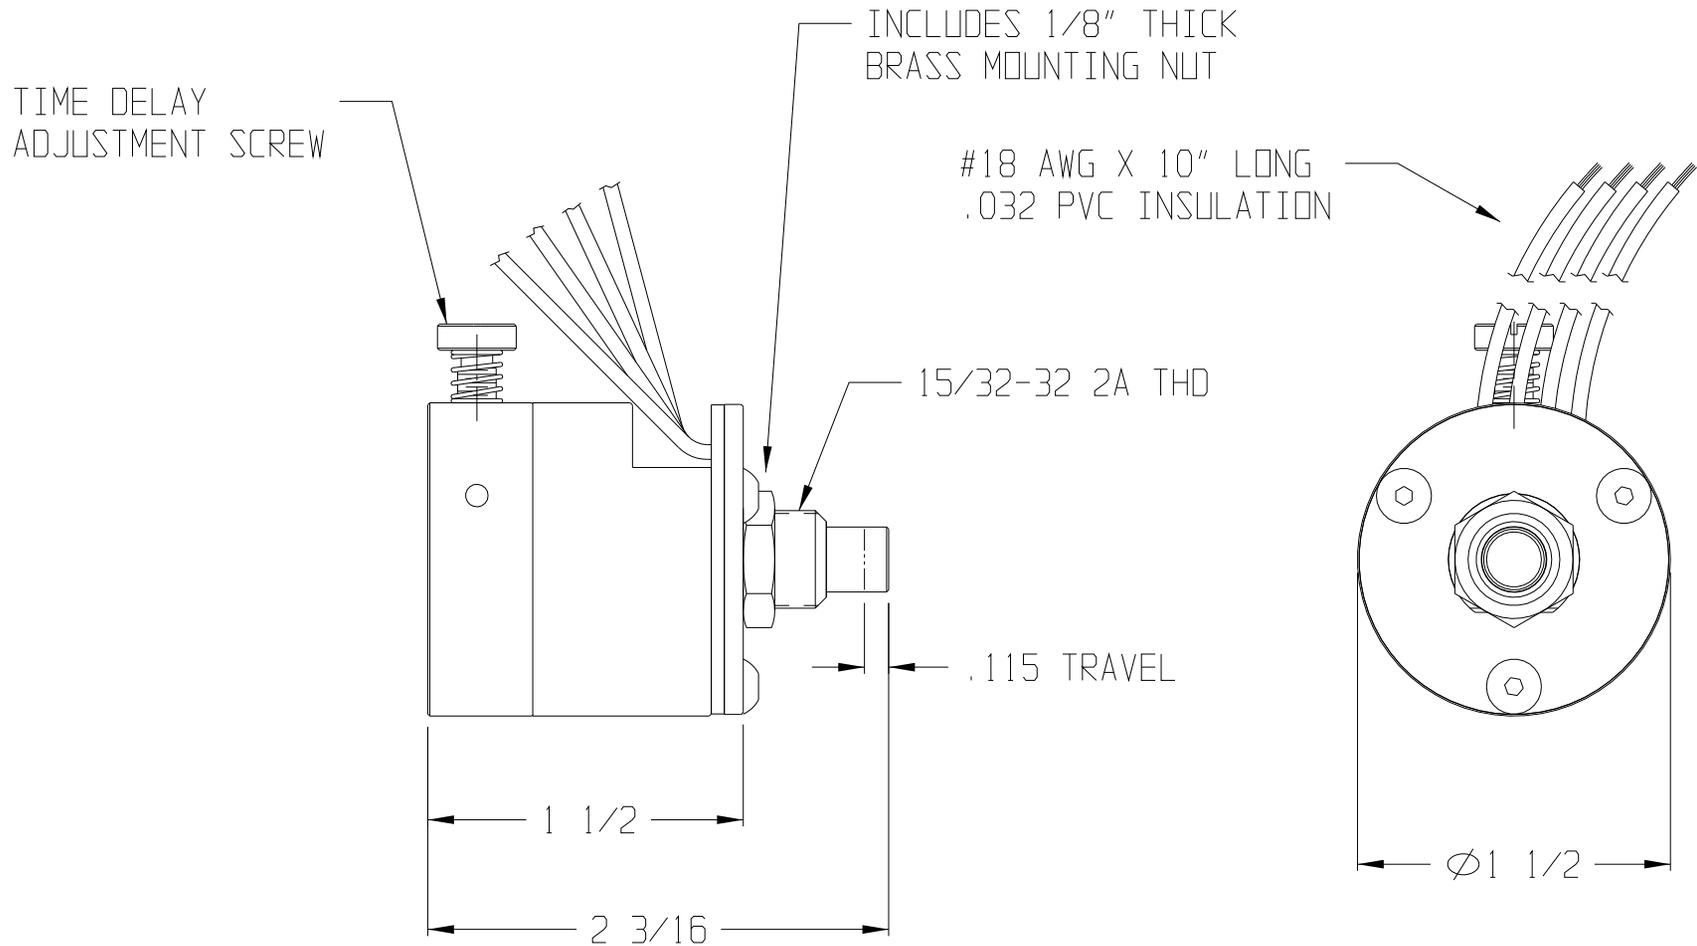

- 4. CONSTRUCTION: 6026 ALUMINUM HOUSING; STAINLESS STEEL PLUNGER.
- 3. FORM Z CONTACT CONFIGURATION
- 2. SWITCH: 5 AMP 125 VAC

NOTES: 1. WIRES: #18 AWG X 10" LG, 2 WHITE (N.O.) 2 RED (N.C.).

TOLERANCES (EXCEPT AS NOTED)		<div style="text-align: center;">  <p>SECURITY PRODUCTS, LLC</p> <p>290 PRATT STREET, 4TH FLOOR, MERIDEN, CT 06450</p> </div>			
DECIMAL	± -				
FRACTIONAL	± -	DATA SHEET - PNEUMATIC TIMER, FORM Z			
ANGULAR	± -	DATE 11/19/09	DRAWING NUMBER 750-1000		REV. -